
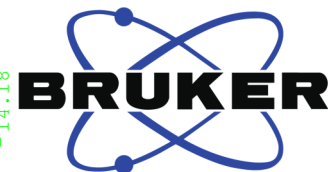


rTCO-DMEDA-Tyr (mPEG7) -BODIPY

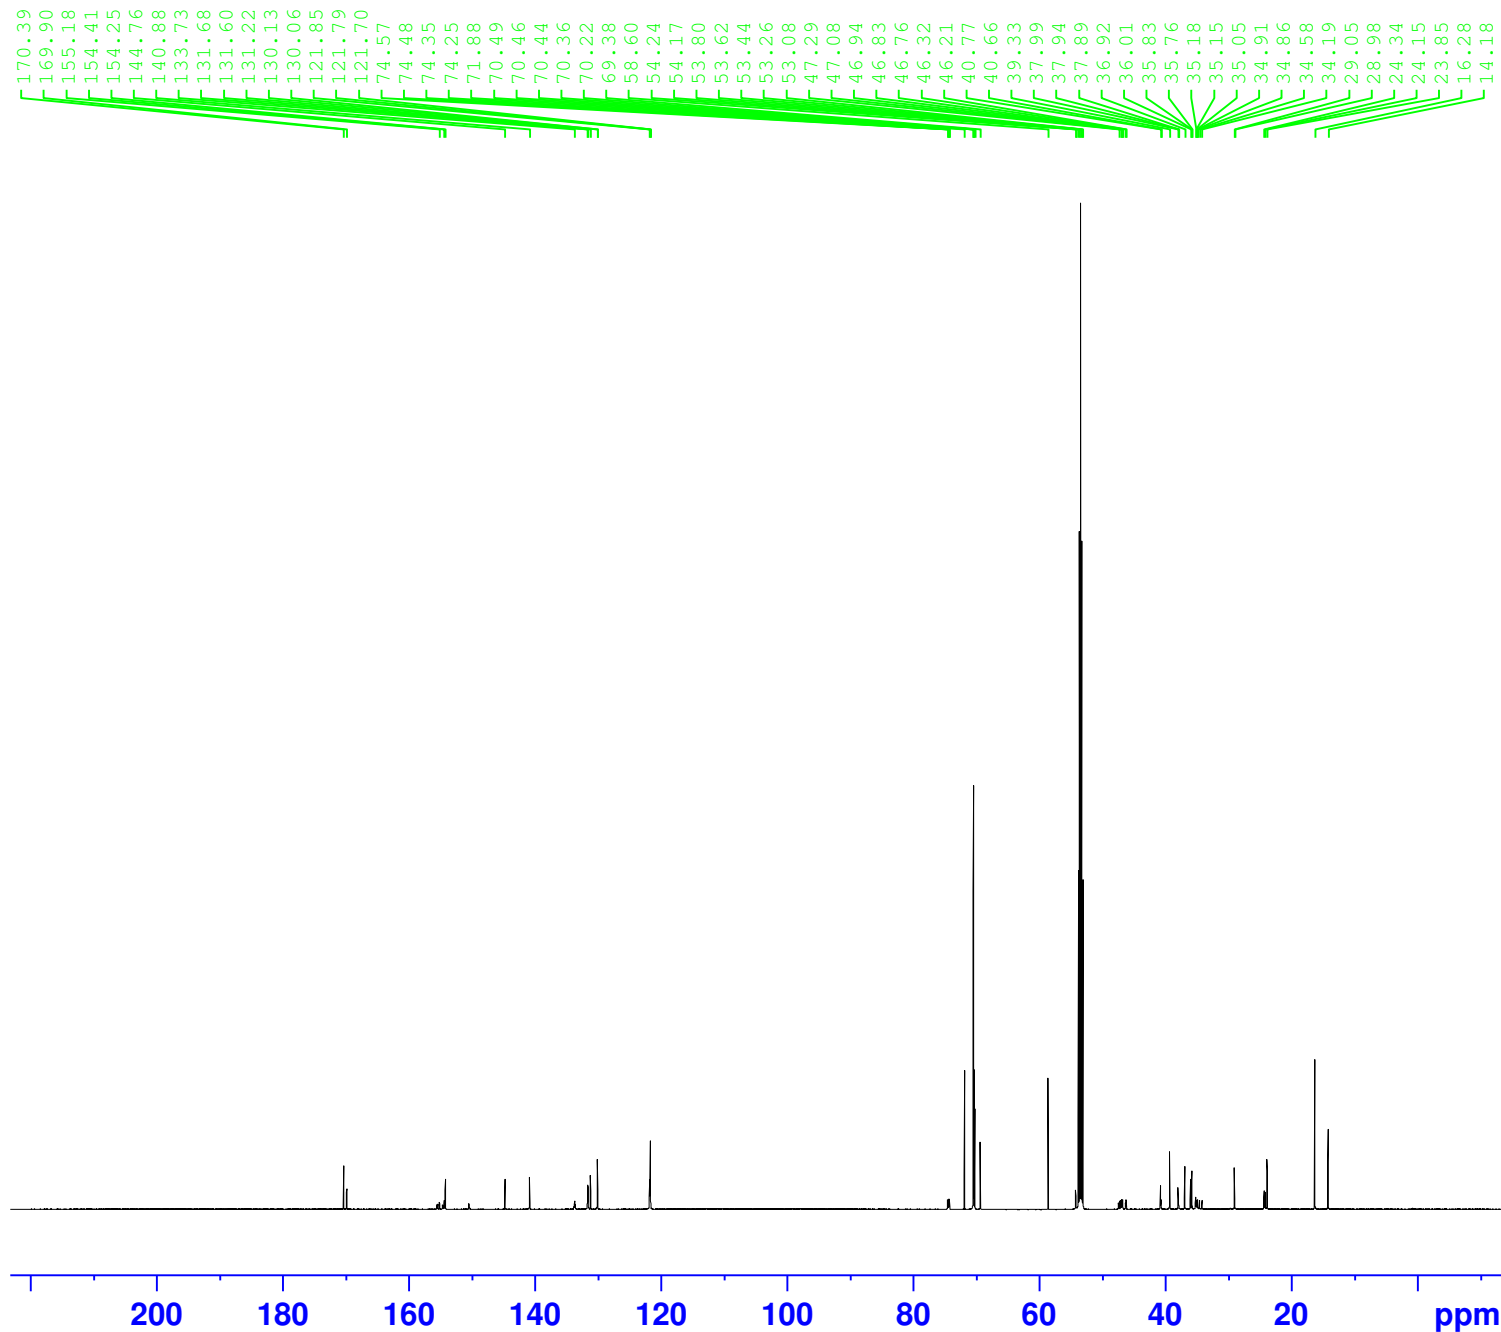

Current Data Parameters
NAME PKE133
EXPNO 11
PROCNO 1

F2 - Acquisition Parameters
Date_ 20200520
Time 10.02 h
INSTRUM spect
PROBHD Z126545_0009 (
PULPROG zgpg30
TD 65536
SOLVENT CD2Cl2
NS 16384
DS 4
SWH 35714.285 Hz
FIDRES 1.089913 Hz
AQ 0.9175040 sec
RG 194.73
DW 14.000 usec
DE 18.00 usec
TE 298.0 K
D1 2.00000000 sec
D11 0.03000000 sec
TD0 1
SFO1 150.9236829 MHz
NUC1 13C
P1 10.00 usec
PLW1 58.00000000 W
SFO2 600.1524006 MHz
NUC2 1H
CPDPRG[2] waltz16
PCPD2 70.00 usec
PLW2 24.71599960 W
PLW12 0.72636002 W
PLW13 0.36535001 W

F2 - Processing parameters
SI 32768
SF 150.9078375 MHz
WDW EM
SSB 0
LB 1.00 Hz
GB 0
PC 1.40